# MRCOOL® Signature Series Multi-Position AHU Electric Heat Kit Installation & Owner's Manual

MODELS:
MCAEHFD\*X1AA

Read this manual carefully before installation and keep it where the operator can easily find it for future reference.

Due to updates and constantly improving performance, the information and instructions within this manual are subject to change without notice.

Version Date: September 4, 2025 Please visit www.mrcool.com/documentation to ensure you have the latest version of this manual.



### **CONTENTS**

### CONTENTS

	SAFETY	
2	INSTALLATION	. 2
	2.1 Start-Up & Checks	
3	2.2 Strip InstallationWIRING DIAGRAMS	. 5
4	SPECIFICATIONS	. 7

### **Safety Precautions**

### **Read Before Using**

Incorrect usage may cause serious damage or injury.

The symbols below are used throughout this manual to indicate instructions that should be followed closely or actions that should be avoided to prevent death, injury, and/or property damage.



Indicates a medium level of risk which, if not avoided, may result in death or serious injury.



Indicates a low degree of risk which, if not avoided, may result in minor or moderate injury.

## **!** WARNING

Hazardous Voltage- Disconnect Power Before Servicing.

### ! CAUTION

- Sharp metal edges can cause injury. When installing this unit, use care to avoid sharp edges. Wear proper personal protective equipment at all times. Have a fire extinguisher available. Read these instructions thoroughly and follow all warnings and cautions included in literature and attached to the system.
- If this unit is installed in a mobile or manufactured home application, the ductwork must be sized to achieve static pressures within the manufacturer's guidelines. All other installation guidelines must be followed. Failure to do so may result in equipment damage, personal injury, and improper performance of the unit.

### **!** WARNING

This product contains fiberglass wool insulation. Fiberglass dust and ceramic fibers are believed by the state of California to cause cancer through inhalation. Glasswool fibers may also cause respiratory, skin, or eye irritation.

### **Precautionary Measures**

- Avoid breathing fiberglass dust.
- Use a NIOSH approved dust/mist respirator.
- Avoid contact with the skin or eyes. Wear long-sleeves, loose fitting clothing, gloves, and eye protection.
- Wash clothes separately from other clothing, rinse your washer thoroughly.
- Operations, such as sawing, blowing, tear-out, and spraying may generate fiber concentrations requiring additional respiratory protection. Use the appropriate NIOSH approved respirator in these situations.

### First Aid Measures

- Eye contact: Flush eyes with water to remove dust. If symptoms persist, seek medical attention.
- Skin contact: Wash affected area gently with soap and warm water after handling.

### Read the whole instruction manual before starting the installation.

Before performing installation, service, or maintenance operations on this system, turn off all main power switches. There may be more than one disconnect. Turn off the accessory heater power switch if applicable. Electrical shocks can cause personal injury or death. When installed in a garage the heater elements should have a clearance of 18in (45.72cm) from the floor, insure that the area is well ventilated.


### Reminder:

Installation and servicing of this equipment should only be performed by trained and qualified personnel. If these instructions and/or codes are not followed or if the equipment is not properly installed, possible injury or death can occur during installation or operation.

Remember, it is YOUR responsibility to install the product safely and to know it well enough to be able to instruct a customer on its safe use.


### 2.1 Start-Up & Checks

1. Remove the blower access panel of the air handler unit.

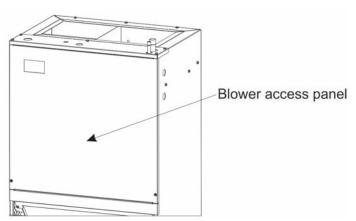


# 2 INSTALLATION

2. Based on the circuit breaker quantity, remove the heater block-off plate and save the screws for mounting the heater kit.

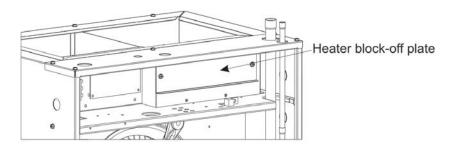


3. Based on the circuit breaker quantity, remove the circuit breaker knockout(s) in the unit access panel.




### 2.2 Strip Installation

1. Position and slide the heater assembly into the blower section through the access opening. Secure the heater into place with the screws removed from the block-off plate.

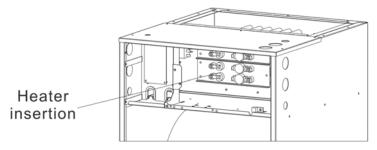

2. Secure the bracket to the cabinet mounting rail with the screws provided. Be sure to insert the supporting rods into the provided holes.

Be sure to insert the supporting




### ! CAUTION

To prevent damage, carefully insert the electric heating assembly through the rectangular opening in the front of the discharge opening so the heat element support rod is seated into the hole on the back side of the discharge opening.

3. Place the circuit breakers onto the breaker bracket, as shown below. Secure the breaker bracket to the cabinet mounting rail with the screws provided, making sure that all wiring is rounded away from any sharp

edges.

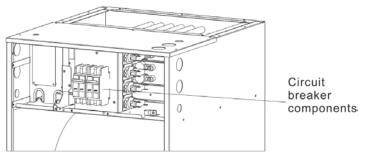

### 4. Wiring:

- 1. Connect the plug group to the control circuit board of the air handler according to the wiring diagram (heater ≤ 10kW connect 2 pins only, heater > 10kW connect 3 pins).
- 2. Connect high voltage to the circuit breaker lugs and ground lug per the wiring schematic and air handler installation guide.


### 5. Check Out:


- 1. Check for loose terminal connections.
- 2. Check that all fuse and circuit breaker short circuit interruption ratings are adequate.
- 3. Turn on the unit and the electric heaters power.
- 4. Set the thermostat to call for heat and check the operation of the heater.
- 6. Reinstall the blower access panel of the air handler.

# 3 WIRING DIAGRAMS

### - Wiring Diagrams

Note: All heat kits must be protected by the correct amp breaker inside the breaker panel. Refer to the table on page 8 for correct amperage.

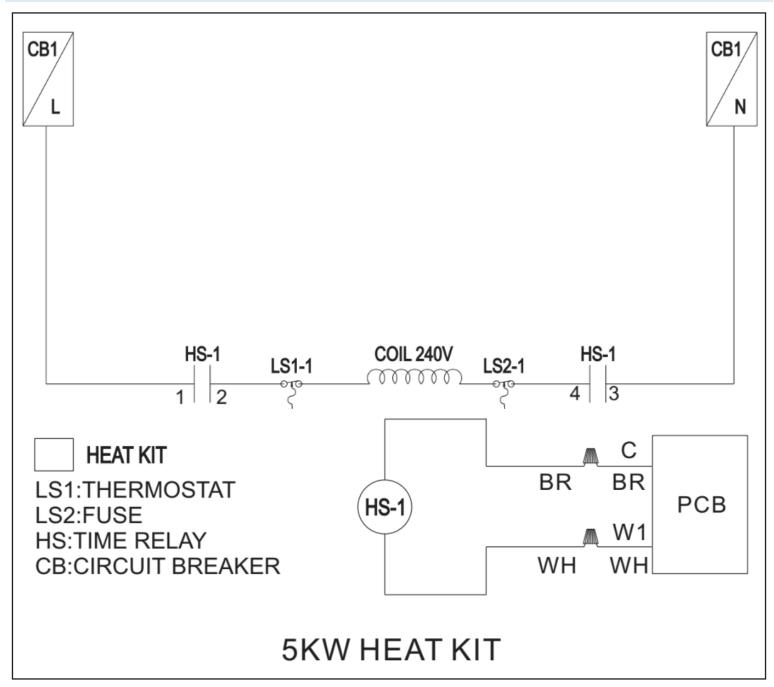

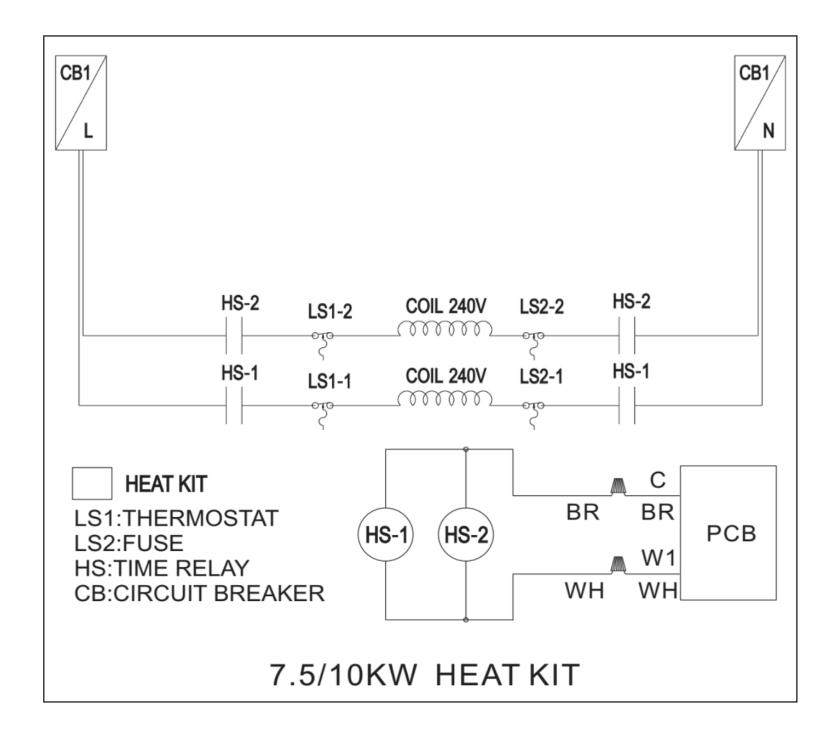



### - Specifications

### **IMPORTANT**

The electric heat accessory includes one 60 amp circuit breaker to provide an electrical disconnect for service personnel that is intended to help protect internal electrical components in the event of a short circuit or ground fault. As designed, the circuit breakers supplied in the accessory do not provide over current protection of the branch circuit. Therefore, the branch circuit(s) should be sized and protected according to the unit nameplate. The electric heater is shipped as an accessory and installed on-site.

Heater Data								
Heater Model	Phase	Frequency	Voltage	Capacity	Heater Amps			
MCAEHFD5X1AA	1	60Hz	240V	5kW	20.84			
MCAEHFD7X1AA	1	60Hz	240V	7.5kW	31.25			
MCAEHFD10X1AA	1	60Hz	240V	10kW	41.67			
Note: For model specific electrical data, refer to the air handlers installation manual.								
Heating kW Correction Factor								
Supply Voltage	240	230	220	210	208			
Correction Factor	1	0.92	0.84	0.77	0.75			
Electrical Data for Stud Mount Air Handlers								
Model	Heater Kit Usage	MCA (Min. Circuit Ampacity)		MOP (Max. Fuse or Breaker (HACR) Ampacity)				
		208V	230V	208V	230V			
18K	MCAEHFD5X1AA	22.8	24.9	25	25			
ION	MCAEHFD7X1AA	34.8	37.9	35	40			
	MCAEHFD5X1AA	22.8	24.9	25	25			
24K	MCAEHFD7X1AA	34.8	37.9	35	40			
	MCAEHFD10X1AA	45.4	49.8	50	50			
	MCAEHFD5X1AA	22.8	24.9	25	25			
30K	MCAEHFD7X1AA	34.8	37.9	35	40			
	MCAEHFD10X1AA	45.4	49.8	50	50			
	MCAEHFD5X1AA	22.8	24.9	25	25			
36K	MCAEHFD7X1AA	34.8	37.9	35	40			
	MCAEHFD10X1AA	45.4	49.8	50	50			
	MCAEHFD5X1AA	22.8	24.9	25	25			
42K	MCAEHFD7X1AA	34.8	37.9	35	40			
	MCAEHFD10X1AA	45.4	49.8	50	50			
	MCAEHFD5X1AA	22.8	24.9	25	25			
48K	MCAEHFD7X1AA	34.8	37.9	35	40			
	MCAEHFD10X1AA	45.4	49.8	50	50			
	MCAEHFD5X1AA	22.8	24.9	25	25			
60K	MCAEHFD7X1AA	34.8	37.9	35	40			
	MCAEHFD10X1AA	45.4	49.8	50	50			



# MRCOOL® Signature Series Multi-Position AHU Electric Heat Kit

The design and specifications of this product and/or manual are subject to change without prior notice.

Consult with the sales agency or manufacturer for details.